

DC EXHIBIT J

KEYNOTES


- 1 NEW 400-AMP, 120/208V 3Ø 4W MAIN SERVICE/METER SWITCHBOARD PER ROSEVILLE ELECTRIC AND EUSERC REQUIREMENTS. FINAL LOCATION PENDING UTILITY COORDINATION AND APPROVAL.
- 2 2'x3' PULL BOX FOR SERVICE CONDUCTOR INTERFACE.
- 3 SERVICE LATERAL TRENCHING, CONDUIT, STRUCTURES, CONDUCTORS AND BACKFILL SHALL BE PER ROSEVILLE ELECTRIC UNDERGROUND SERVICE REQUIREMENTS.
- 4 SITE LIGHTING CONTROL PANEL

REVISIONS

NO.	DESCRIPTION



THIS DOCUMENT, AND THE ELECTRICAL DESIGN DETAILS AND CONTENT INCORPORATED HEREIN, AS AN INSTRUMENT OF PROFESSIONAL SERVICE, IS THE PROPERTY OF THOMAS A. BYERLY, P.E. AND IS NOT TO BE USED, IN WHOLE OR IN PART, FOR ANY OTHER PROJECT WITHOUT WRITTEN AUTHORIZATION.

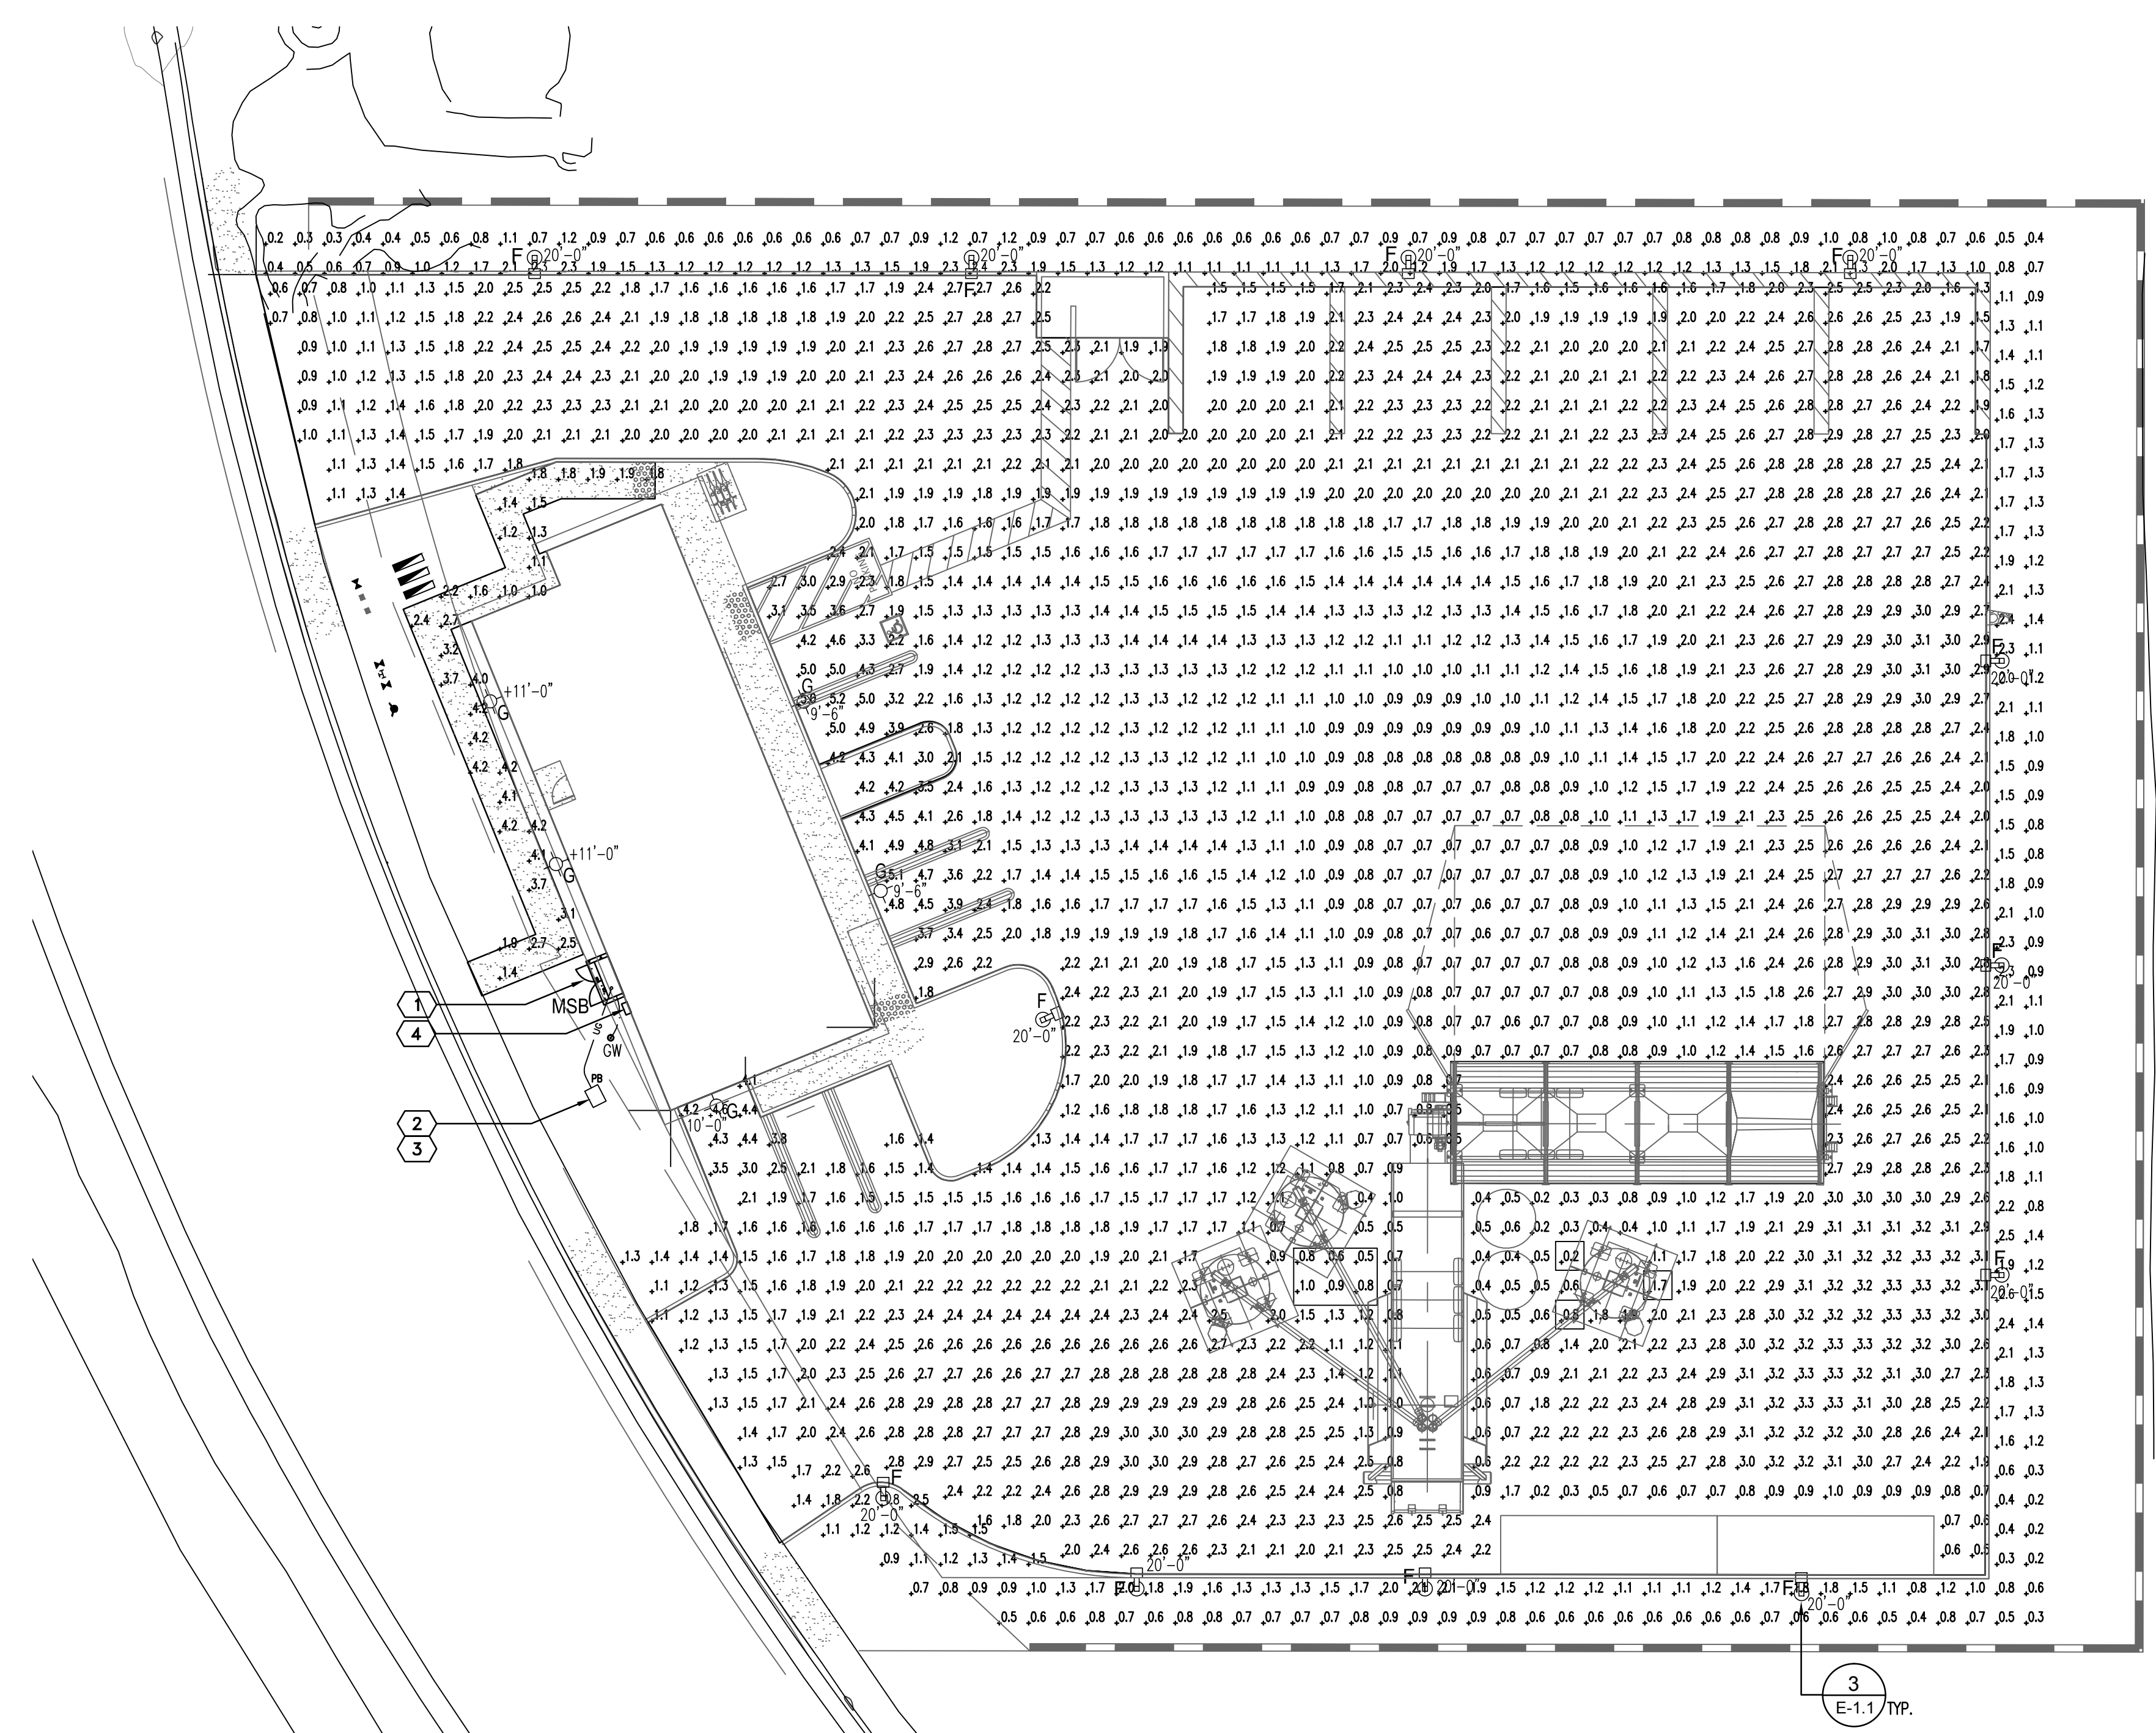

AVE.	MAX.	MIN.	MAX:MIN	AVE:MIN
2.0	5.2	0.2	26	10

Per Visual Lighting Software 2020

EXTERIOR FIXTURE SCHEDULE

FIXTURE	DESCRIPTION	WATTS	VA	MFR./MODEL
F	LED AREA LUMINAIRE, POLE-MTD, 120-277V, 4000K, 54 WATTS, QTY: 30-LED, 6,816 LUMENS, TYPE T4M DISTRIBUTION, BUG: B100GZ, FURNISH WITH HOUSE SIDE SHIELD	54	56	LITHONIA DSX1 LED P1 40K T4M MVOLT OR EQUAL
G	LED LUMINAIRE, BLDG.-MTD, 120, 4000K, 19 WATTS, QTY: 10-LED, 2,205 LUMENS, TYPE T2S SHORT DISTRIBUTION.	19	20	LITHONIA DSXW1 LED 10C S30 40K T2S MVOLT OR EQUAL

FIXTURE MFR./MODEL NOS. SHOWN FOR REFERENCE. CONFIRM ALL LIGHT FIXTURE SELECTIONS WITH OWNER PRIOR TO CONSTRUCTION.

NOTE: ALL INSTALLED FIXTURES SHALL BE LED.

SEE SHEET E-1.1 FOR SITE LIGHTING FIXTURE DETAILS

